


NOTES

1. A LOCKING STYLE MANHOLE COVER MAY BE REQUIRED AT THE REQUEST OF SSSD. SEE SSSD DESIGN STANDARDS SEC. 2.4(f) FOR SPECIFIC REQUIREMENTS.

2. THE MINIMUM WEIGHT FOR THE COMBINED RING & COVER SHALL NOT BE LESS THAN 275 LBS.

PLAN

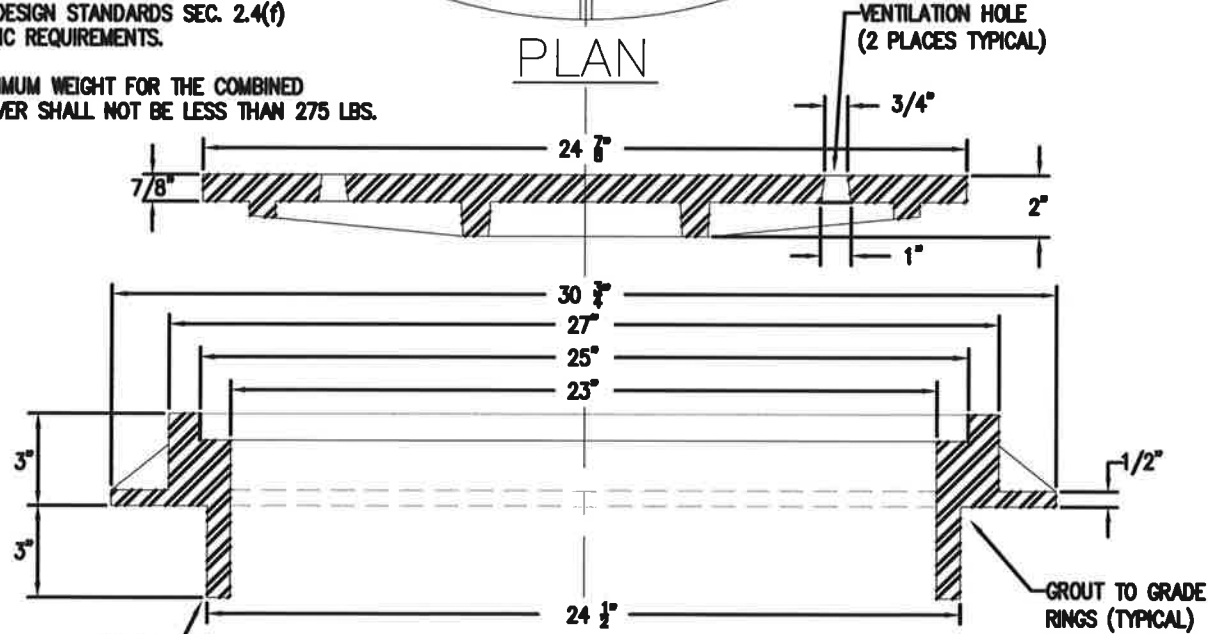

PROFILE

FRAME SHALL BE U.S.F. TYPE 420C CAST IRON.

SCALE: N.T.S.

SOUTH SUBURBAN SANITARY DISTRICT

Drawn By: MDR
Adkins Consulting Engineers, Inc.

**STANDARD MANHOLE
FRAME & COVER**

Approved By: *SSSD*

Dwg. No.:

SD-1